

TYPICAL DRAWING NOT FOR CONSTRUCTION




- 1. INLET AND OUTLET PIPE CAN BE UP TO 90 DEGREES APART DEPENDING ON PIPE AND MANHOLE SIZE. IF IN DOUBT, PLEASE CONTACT RAINWATER MANAGEMENT.
- 2. THE RWM SS UNIT CAN HANDLE MULTIPLE INLET PIPES AS WELL AS A TOP INLET.

GENERAL NOTES

- 1. RAINWATER MANAGEMENT TO PROVIDE ALL MATERIALS UNLESS NOTED OTHERWISE.
- 2. ALL DIMENSIONS ARE SHOWN IN MILLIMETERS.
- 3. FOR FABRICATION DRAWINGS WITH DETAILED STRUCTURE DIMENSIONS AND WEIGHTS, CONTACT RAINWATER MANAGEMENT. www.rainwatermanagement.ca
- 4. RWM WATER QUALITY STRUCTURE SHALL BE IN ACCORDANCE WITH ALL DESIGN DATA AND INFORMATION CONTAINED IN THIS DRAWING.
- 5. STRUCTURE AND CASTINGS SHALL MEET REQUIRED LOAD RATINGS, ASSUMING GROUNDWATER ELEVATION AT, OR BELOW THE OUTLET PIPE INVERT ELEVATION. ENGINEER OF RECORD TO CONFIRM ACTUAL GROUNDWATER ELEVATION.
- 6. MANHOLE MANUFACTURED TO LOCAL SPECIFICATIONS.

INSTALLATION NOTES

- 1. ANY SUB-BASE, BACKFILL DEPTH, AND/OR ANTI-FLOTATION PROVISIONS ARE SITE-SPECIFIC DESIGN CONSIDERATIONS AND SHALL BE SPECIFIED BY THE ENGINEER OF RECORD.
- 2. CONTRACTOR TO PROVIDE EQUIPMENT WITH SUFFICIENT LIFTING AND REACH CAPACITY TO LIFT AND SET THE MANHOLE STRUCTURE (LIFTING DEVICES NOT PROVIDED). HEAVIEST LIFT DEPENDS ON RISER HEIGHTS.
- 3. CONTRACTOR TO ADD GASKETS OR JOINT SEALANT BETWEEN ALL STRUCTURE SECTIONS, AND ASSEMBLE STRUCTURE AS REQUIRED.
- 4. CONTRACTOR TO PROVIDE, INSTALL, AND GROUT PIPES, MATCH PIPE INVERTS WITH ELEVATIONS SHOWN.
- 5. CONTRACTOR TO TAKE APPROPRIATE MEASURES TO ASSURE UNIT IS WATER TIGHT. IT IS SUGGESTED THAT ALL JOINTS BELOW PIPE INVERTS ARE GROUTED.

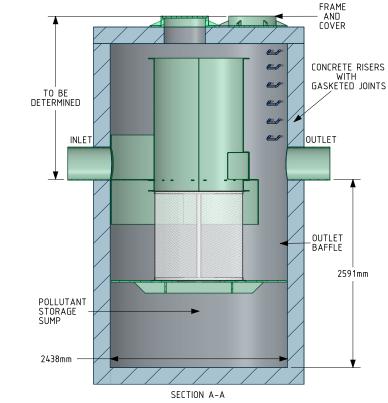

rainwater. MANAGEMENT

www.rainwatermanagment.ca 604-944-9265

RWM-SS-2400 TYPICAL		RWM-SS-2400			
JOB / IDENTIFIER SS		REV	CREATOR AG	APPROVED	SHEET 1 of 1
MATERIAL	THICKNESS	SCALE 1:52	CREATED 11/15/2022	LAST SAVED 11/15/2022 11:41:47 AM	